


CATALOG **143**



**Polymer
Station Post Insulators
for 69 to 345 kV
Applications**

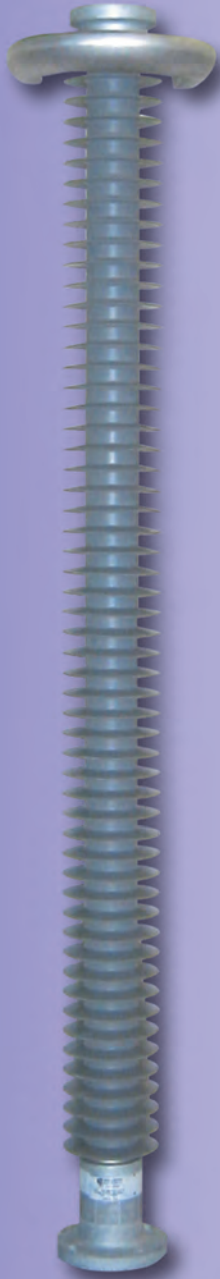

NGK-Locke Polymer Insulators, Inc.
Virginia Beach, Virginia, U.S.A.


TABLE of CONTENTS

Polymer Station Post Insulators..... 1
 Application Guidelines for Polymer Station Posts (SP) 2
 Catalog Number System 3
 Corona Ring Application 3
 Standard Strength Station Post Application with 2.5” Core 4
 High Strength Station Post Application with 3.5” Core 5
 Research & Development 6
 Packaging 6

NGK-Locke Polymer Insulators, Inc. management systems comply with the requirements of ISO 9001:2008 (Certificate #FM36580, since 1997) and ISO 14001:2004 (Certificate #EMS96014, since 2005); the registrar for both certificates is BSI Group America Inc., based in Reston, Virginia.


Polymer Station Post Insulators

NGK-Locke Polymer Insulators (NLPI) provides polymer station post (SP) insulators that are manufactured using the same unsurpassed designs, materials, and quality control used in our polymer suspension & line post insulators. Our end fitting sealing system employs **double O-rings plus an RTV sealant** that have demonstrated excellent protection against moisture penetration. The housing material is **silicone** rubber, which provides excellent contamination performance. This housing is formed by compression molding silicone rubber onto the core as one continuous part free of any joints. Both housing and core are **chemically bonded** together during the vulcanization process. The strength of this bond is greater than the tearing strength of the silicone housing material itself. End fittings are then assembled by a **pressure controlled, multi-step, crimping process**. Overall length and hole alignment are controlled by NLPI’s unique design and manufacturing process.

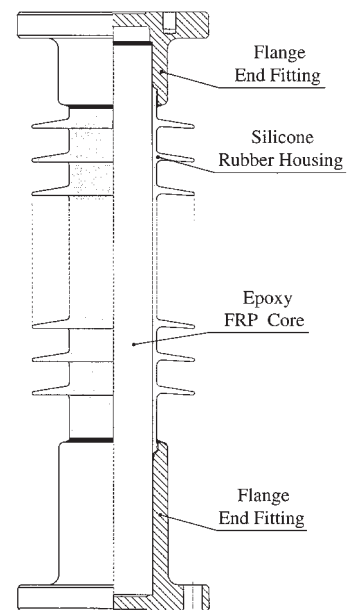


Polymer SP Structure

This process provides the SP with more severe tolerances required for substation equipment. As shown below, NLPI's polymer station post insulators have excellent seismic performance due to their flexibility. NLPI produces polymer SP with a 2.5" and a 3.5" diameter solid core.

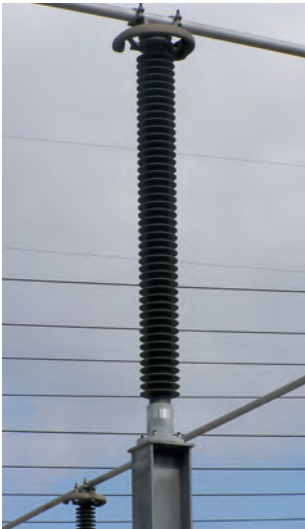

230kV, 3.5" SP (Bus Support)

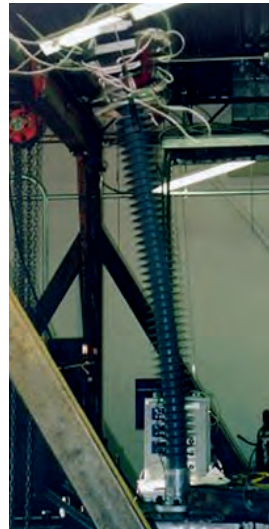

Seismic Test on 230kV, 3.5" SP
in accordance with IEEE 693



69kV, 3.5" SP

Application Guidelines for Polymer Station Posts (SP)

- NLPI's SP complies with dimensional and electrical values in accordance with ANSI C29.9 Technical Reference (TR) Number. The cantilever and tension strengths exceed the required values of the ANSI standard. Compression and torsion strengths are given as guaranteed values.
- Specified Cantilever Load (SCL) is breaking load guaranteed by manufacturer and should be less than Cantilever Breaking Load (CBL), which is the maximum load reached during a cantilever breaking test.
- The deflection values shown in this catalog correspond to the deflections measured at the relevant ANSI TR porcelain's Maximum Working Load (MWL is specified as 40% of the ANSI TR porcelain's cantilever strength).
- SP for underhung applications are also available. Contact your NGK representative for more information.

CATALOG NUMBER SYSTEM

S 2 - S N 4 7 1 - 2 2 - W

Type of Insulator
S: Station Post

Core Dia.
2: 2.5"
4: 3.5"

Shed Shape
N: Standard Leakage
G: Bigger Sheds on Both Ends for 2.5" SP
H: Bigger Sheds on Both Ends for 3.5" SP

Number of Sheds





Design Variation

Top Flange Base

Bottom Flange Base

Grading Ring Application
None: BIL750kV & below
W: 11" ring for 2.5" SP
X: 15" ring for 3.5" SP

Corona Ring Application

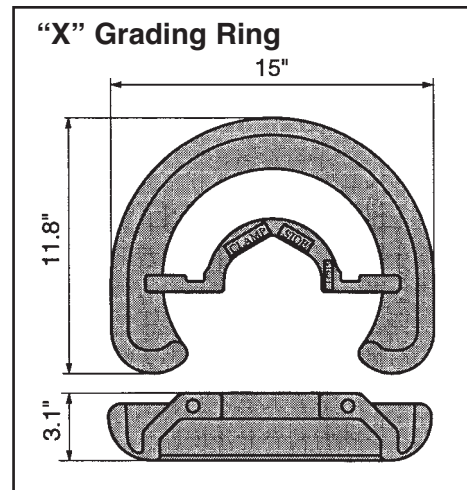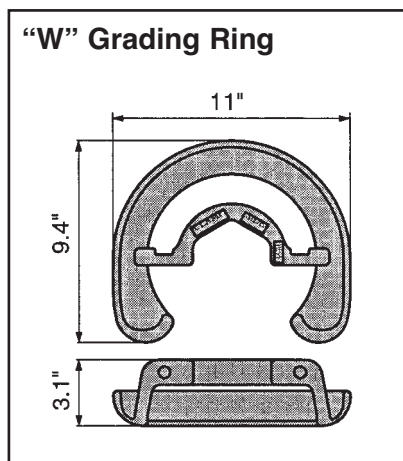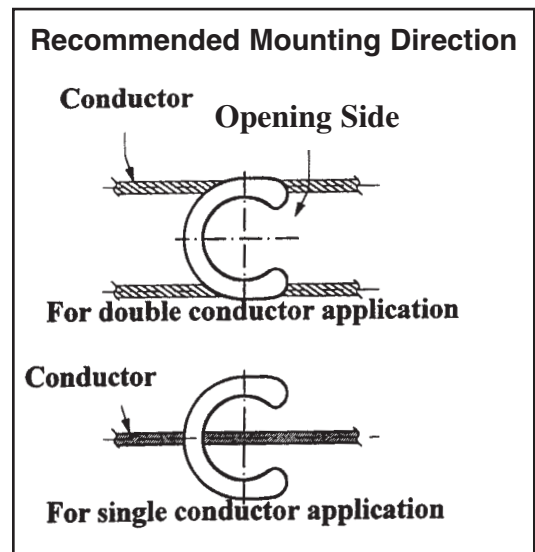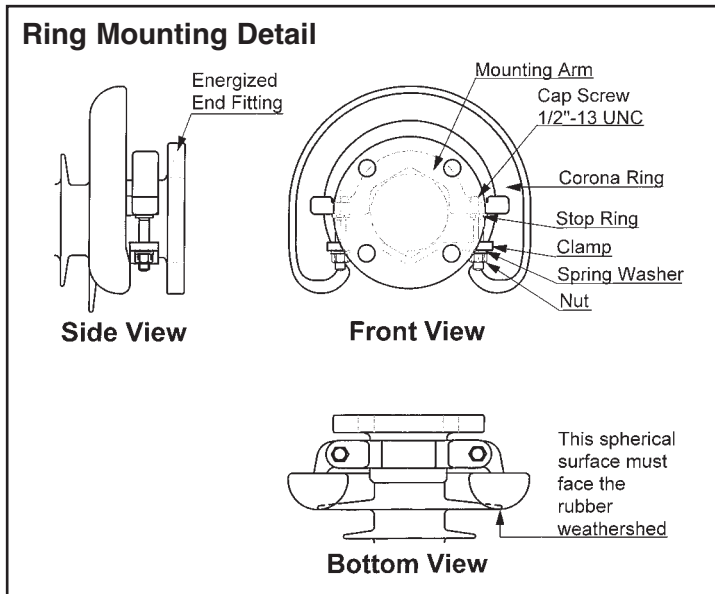



Standard Strength Station Post Application with 2.5" Core

TR ¹	NGK Catalog #	BIL and Impulse Withstand, kV	Height, inch	Leakage distance, inch	Cantilever SCL ² , K lbs.	Compression ³ , K lbs.	Deflection, at TR's MWL ⁴		Critical Impulse Pos., kV	Power-Frequency Wet Withstand, kV	Max. RIV, μ V/kV	Approx. Weight lbs.
							TR's MWL, K lbs.	inch				
278	S2-SG191-21	350	30	78.9	4.5	25.0	1.20	0.8	390	145	200/44	35
286	S2-SG311-21	550	45	128	2.8	12.0	0.68	1.8	610	230	200/73	45
287							1.04	2.7				
288	S2-SN311-21	650	54	129	2.3	8.0	0.56	2.5	710	275	200/88	47
289							0.88	3.9				
291	S2-SN361-21	750	62	150	2.0	6.0	0.48	3.3	810	315	500/103	51
295							0.74	5				
304	S2-SN471-22-W	900	80	196	2.0	3.5	0.38	5.5	1010	385	500/146	67
308							0.58	8.4				
312	S2-SN551-22-W	1050	92	229	1.8	2.5	0.32	6.7	1210	455	500/146	74
316							0.50	10.5				


*1: ANSI Technical Reference Number

*2: Specified Cantilever Load was determined using high strength bolts.
Depending on the grade of bolt, a bolt failure may occur before core failure.


*3: Compression values are based on testing per the procedure specified in ANSI C29.9-1983 using fixed ends.
Actual application conditions may result in different compression strength values.

*4: Deflection measured at the relevant ANSI C29.9-1983 TR porcelain's maximum working load.

Tensile Strength: 25K lbs.
Torsion Strength: 30K in-lbs.

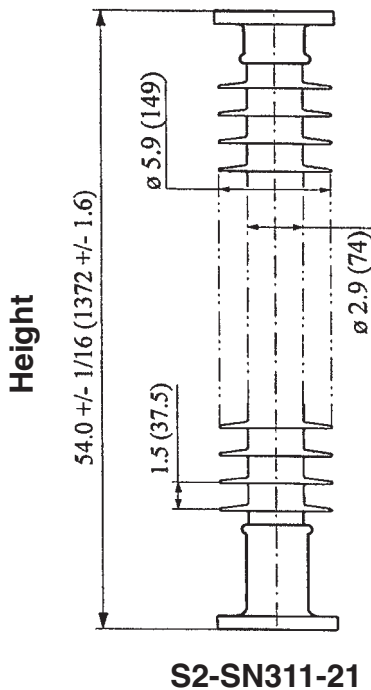

Flange End Fitting Detail

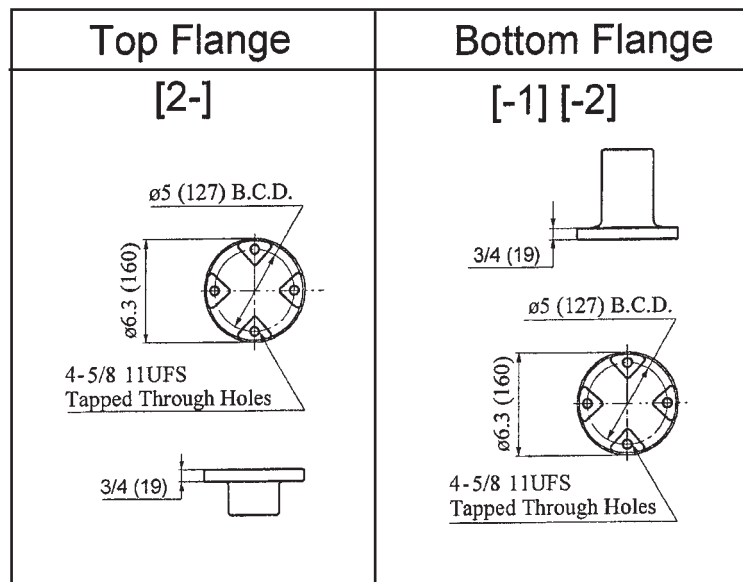

The dimensions are in inches.
The metric equivalents (millimeters) are shown in ().





High Strength Station Post Application with 3.5" Core

TR ¹	NGK Catalog #	BIL and Impulse Withstand, kV	Height, inch	BCD, inch	Leakage distance, inch	Cantilever SCL ³ , K lbs.	Compression ⁴ , K lbs.	Deflection, at TR's MWL ⁵		Critical Impulse Pos., kV	Power-Frequency Wet Withstand, kV	Max. RIV, $\mu\text{V}/\text{kV}$	Approx. Weight lbs.
								TR's MWL, K lbs.	inch				
278	S4-SH151-22	350	30	5	72.9	8.0	45.0	1.20	0.3	390	145	200/44	54
286	S4-SH251-22	550	45	5	117	5.0	45.0	0.68	0.5	610	230	200/73	70
287								1.04	0.8				
288	S4-SN311-22	650	54	5	137	4.1	35.0	0.56	0.8	710	275	200/88	78
289								0.88	1.2				
291	S4-SN361-22	750	62	5	160	3.6	26.0	0.48	1.1	810	315	500/103	86
295								0.74	1.6				
304	S4-SN461-11-X	900	80	5, 7 ²	204	4.5	16.0	0.38	1.6	1010	385	500/146	128
308								0.58	2.4				
312	S4-SN541-11-X	1050	92	5, 7 ²	240	3.9	11.0	0.32	1.9	1210	455	500/146	141
316								0.50	3.0				
324	S4-SN641-13-X	1300	106	5	285	2.3	8.2	0.40	4.0	1410	525	1000/220	156
367 ⁶								0.58	5.7				
369 ⁶								0.82	8.1				
330	S4-SN741-11-X	1470	122	5, 7 ²	329	2.9	6.2	0.36	5.3	1610	590	1000/220	174
371								0.47	6.9				
373								0.70	10.3				

*1: ANSI Technical Reference Number

*2: The mechanical load was determined using a 7-inch BCD mounted specimen. Care should be taken when a specimen is mounted using 5-inch BCD.


*3: Specified Cantilever Load was determined using high strength bolts. Depending on the grade of bolt, a bolt failure may occur before core failure.

*4: Compression values are based on testing per the procedure specified in ANSI C29.9-1983 using fixed ends. Actual application conditions may result in different compression strength values.


*5: Deflection measured at the relevant ANSI C29.9-1983 TR porcelain's maximum working load.

*6: BCD at bottom flange is 5 inch though the porcelain's TR specifies 7 inch BCD.

Tensile Strength: 25K lbs.
Torsion Strength: 55K in-lbs.

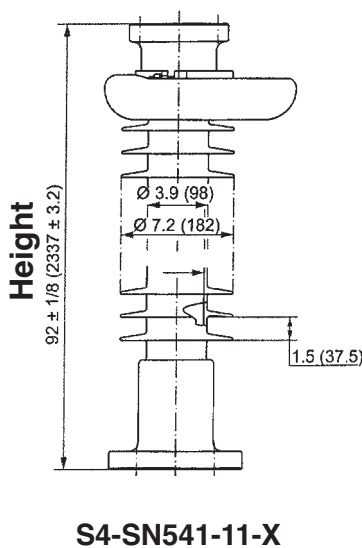

Flange End Fitting Detail

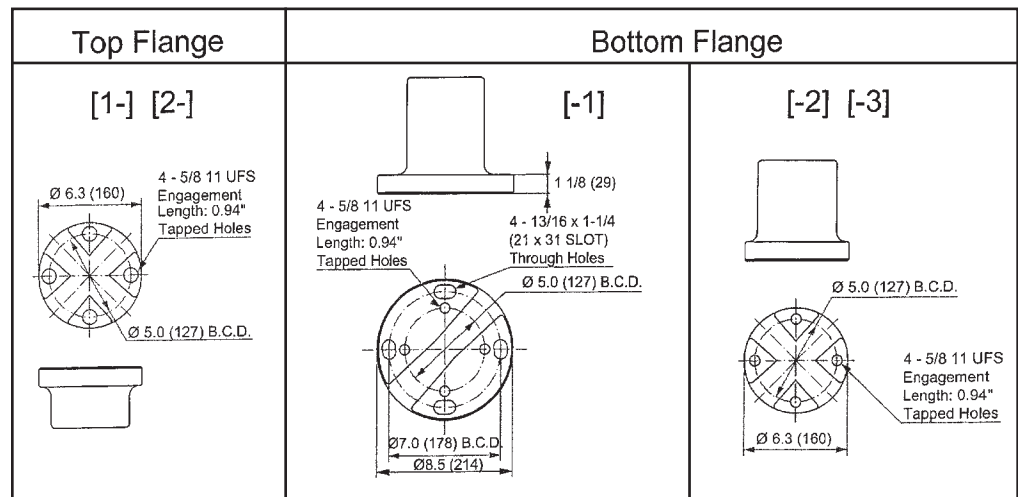


The dimensions are in inches.
 The metric equivalents (millimeters) are shown in ().



Research & Development

The station post insulators were subjected to various mechanical, electrical, and aging tests to validate the design. Some tests and the facilities are introduced in the following.

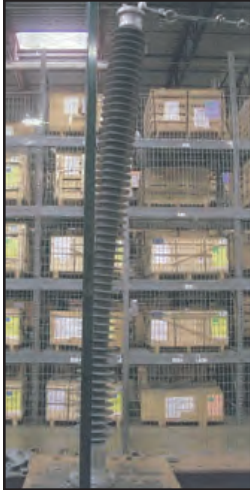


Cantilever Strength Test



Torsion Strength Test



Compression Strength Test

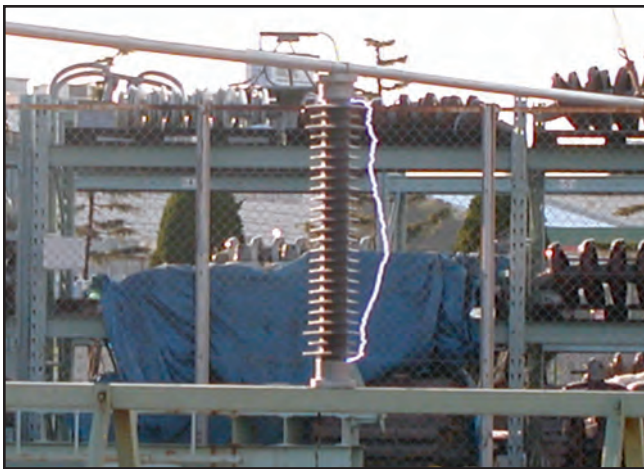

Critical Impulse Flashover Test



Low-Frequency Wet Withstand Test

Packaging

All of NLPI's insulators are packed in weatherproof containers in order to protect the products during land, air, and sea transportation. Several different grades of packaging can be offered depending on the mode of transport and the expected storage conditions. The packaging options that we offer are 1) standard grade/prefabricated packing, 2) economical grade/cardboard carton, and 3) best grade/closed wooden crate. Since the user best knows their crate requirements, they should select the option that is most suited to their needs and include that information in the purchasing specification. Special packaging arrangements can be accommodated upon request.

Each container is marked with the number of insulators it contains, the catalog number, the manufacturer's name, and any other customer requests. Also, a "Polymer Station Post Insulator Handling Instruction" sheet is included with all containers. This sheet states any necessary cautions during handling, transportation, and installation. If corona rings are to be included, a corona ring installation sheet is also provided.



NGK-Locke Polymer Insulators, Inc.

1609 Diamond Springs Road, Virginia Beach, Virginia 23455, U.S.A.

Tel: +1(757) 460-3649 Fax: +1(757) 460-3550

Website: www.ngk-polymer.com

Email: info@ngk-polymer.com



NGK INSULATORS, LTD.

U.S.A.

NGK-Locke, Inc.

Atlanta Office

1880 West Oak Parkway, Suite 104

Marietta, Georgia 30062, U.S.A.

Tel: +1(404) 659-3153 Fax: +1(404) 524-6185

Baltimore Office

2525 Insulator Drive

Baltimore, Maryland 21230, U.S.A.

Tel: +1(410) 347-1700 Fax: +1(410) 347-1724

Los Angeles Office

21250 Hawthorne Blvd., Suite 500

Torrance, California 90503, U.S.A.

Tel: +1(310) 316-3323 Fax: +1(310) 316-3944

Canada

NGK Insulators Canada, Ltd.

Toronto Office

2700 Matheson Blvd. East,

Suite 700 East Tower,

Mississauga L4W 4V9, Ontario, Canada

Tel: +1(905) 602-1266 Fax: +1(905) 238-8247

Montreal Office

1501, Avenue McGill College

Bureau 515

Montreal (Quebec) H3A 3M8, Canada

Tel: +1(514) 281-8488 Fax: +1(514) 281-8596

All Other Countries

NGK Insulators, LTD

Add: 2-56, Suda-cho, Mizuho, Nagoya,

467-8530, Japan

Tel: +81-52-875-7511 Fax: +81-52-872-7530

Web: <http://www.ngk.co.jp/english/index.html>

pr-office@ngk.co.jp

